




RELAY SOCKET

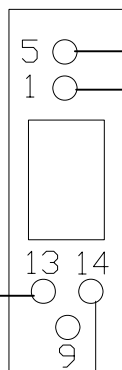

CONTROL UNIT

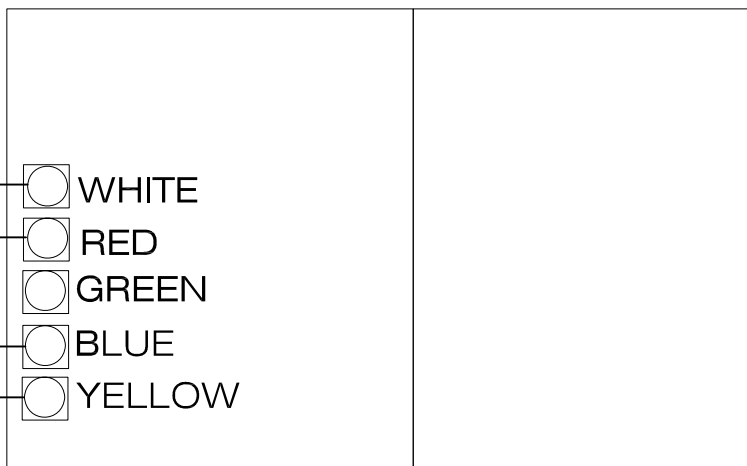

M337 24V

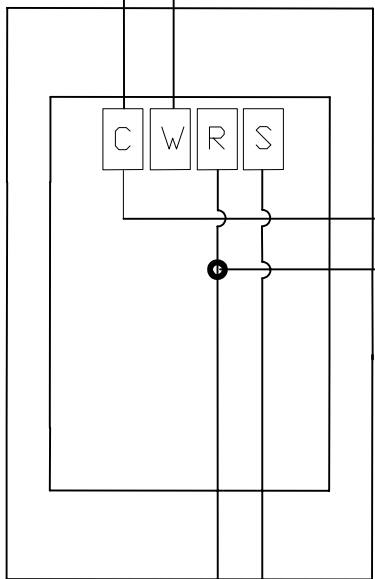

REV	DATE	DESCRIPTION
A	2/17/13	M337 24V Thermostat with Low Voltage M337 24V Activating CBXT Control Unit
DATE: February, 17 2013		DRAWN BY: RJB

HEATIZON SYSTEMS

advanced floor heating/snow and ice removal systems

4137 SOUTH 500 WEST, MURRAY, UTAH 84123 (801) 293-1232 FAX (801) 293-3077